



ACTIONS
1. Implement any necessary WSP actions to keep contamination low.

Why?
Acceptable quality source that does not get contaminated through to consumption.

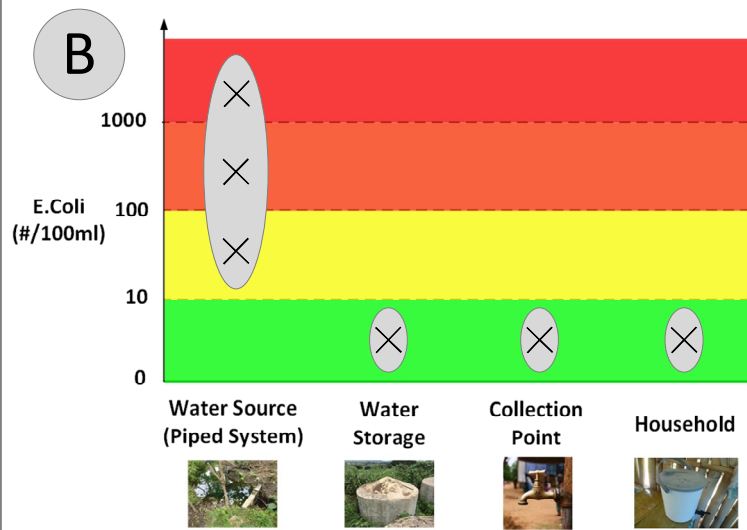


ACTIONS
1. Implement Water Source WSP actions to try and improve.
2. Ensure Household Water Storage and Safe Storage actions are prepared in case quality deteriorates at collection point or household.
3. Implement any other necessary WSP actions.

Why?
Contaminated source where bacteria has died in storage, or water is treated prior to storage. No further contamination.

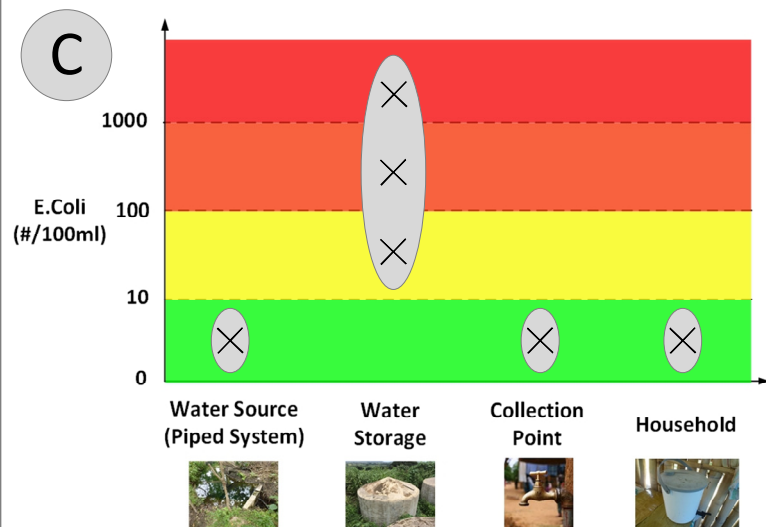


ACTIONS
1. Implement Water Storage WSP actions.
2. Implement all other necessary WSP actions.

Why?
Acceptable quality source contaminated in storage tank. Treated before collection point with no further contamination.

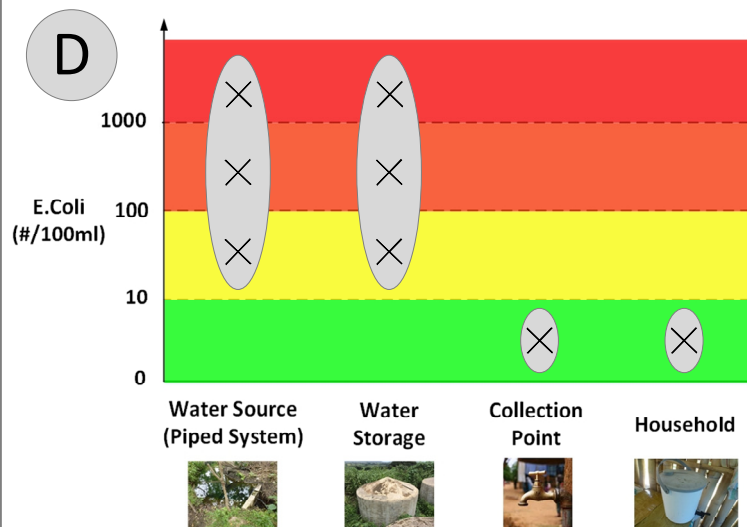

ACTIONS
1. Implement Water Source and Storage WSP actions.
2. Implement all other necessary WSP actions.


Why?
Contaminated source treated before collection point. Stays safe in the home.

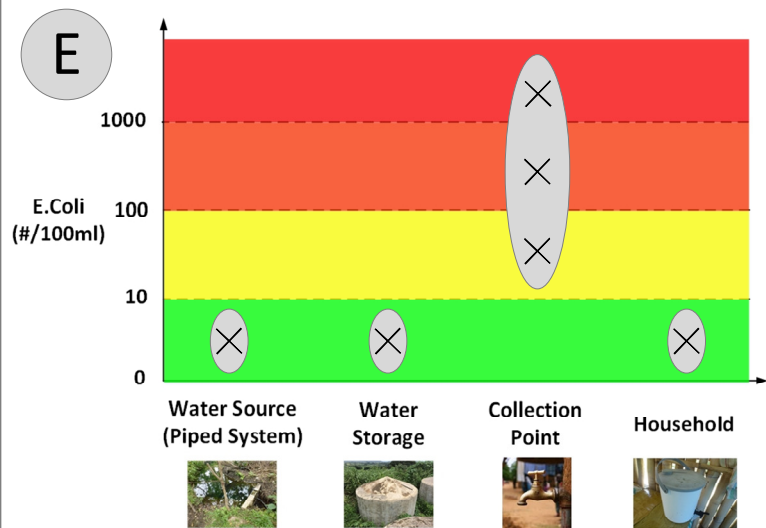

- ACTIONS**
1. Implement Collection Point WSP actions.
 2. Reinforce Household Water Treatment and Safe Storage actions.
 3. Implement all other necessary WSP actions.

Why?


Acceptable quality source contaminated at collection points. Treated at the household.

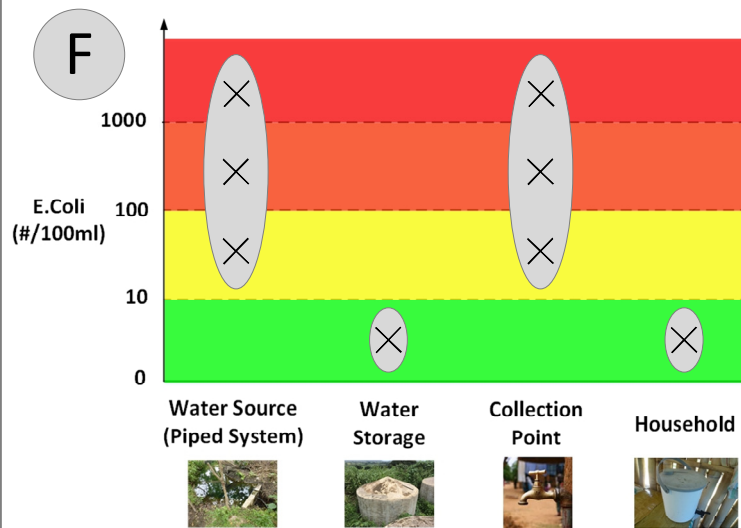

- ACTIONS**
1. Implement Collection Point WSP actions.
 2. Ensure Household Water Storage and Safe Storage actions are prepared.
 3. Implement Water Source WSP actions.
 4. Implement any other necessary WSP actions.

Why?


Contaminated source where bacteria has died in storage, or water is treated prior to storage. Re-contaminated at collection point, but treated at HH.

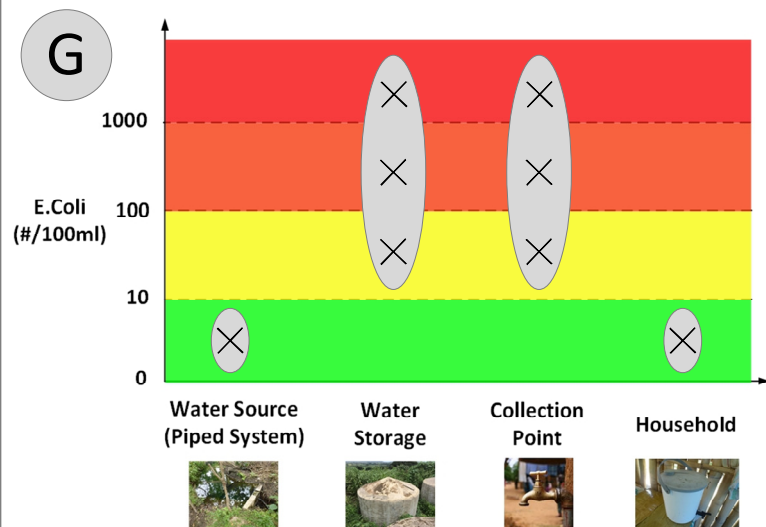

- ACTIONS**
1. Implement Water Storage and Collection Point WSP actions.
 2. Reinforce Household Treatment and Safe Storage WSP actions.
 3. Implement all other necessary WSP actions.

Why?


Acceptable quality source contaminated in storage tank and collection point. Treated in the household.

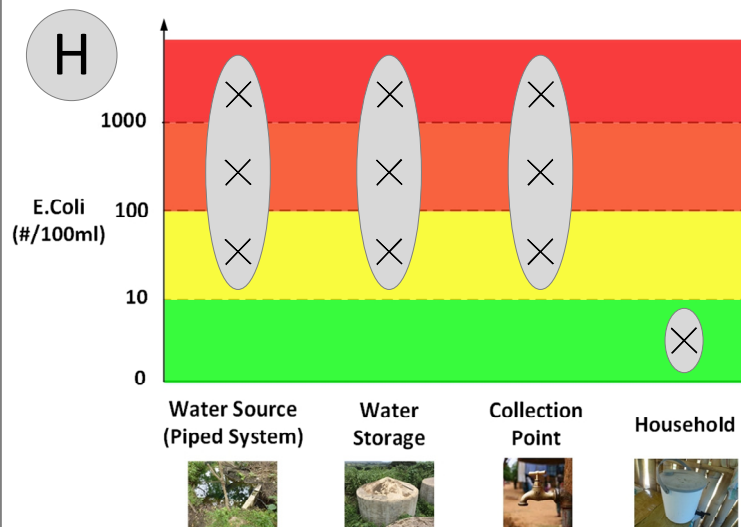

- ACTIONS**
1. Implement Water Source, Storage and Collection Point WSP actions.
 2. Reinforce Household Treatment and Safe Storage WSP actions.

Why?


Contaminated source remains contaminated up to collection point. Treated in the household.

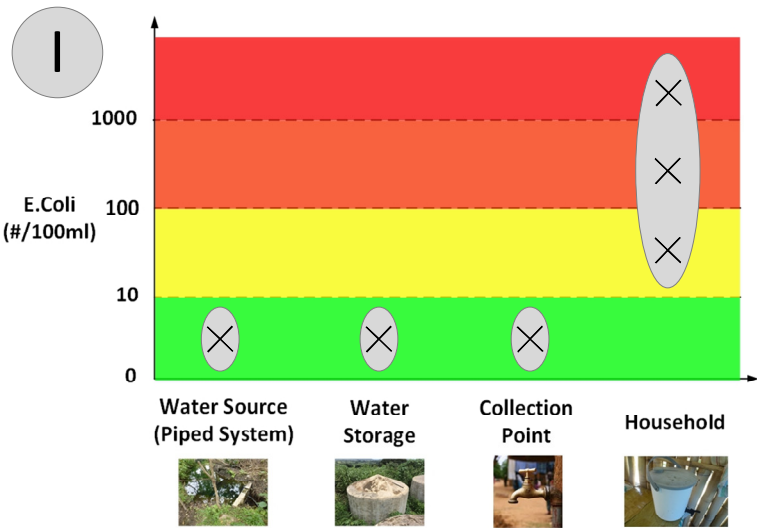

ACTIONS
 1. Implement Household Water Treatment and Safe Storage actions.
 2. Implement all other necessary WSP actions.

Why?


Clean water delivered but then contaminated in the household.

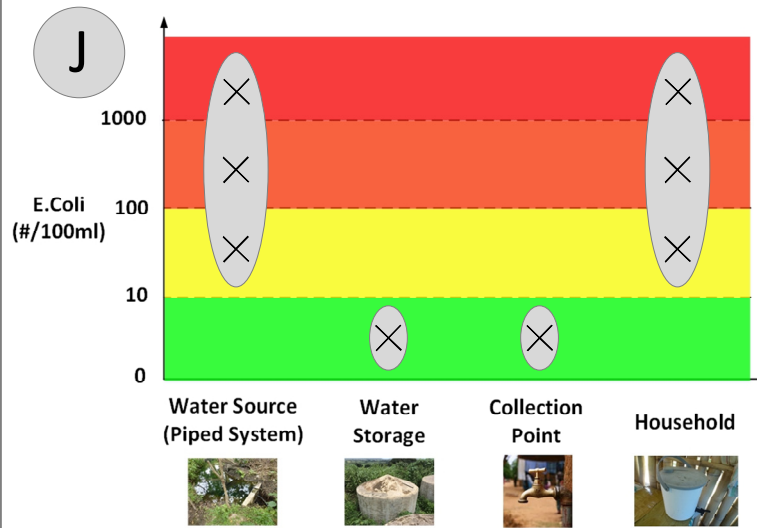

ACTIONS
 1. Implement Household Water Treatment and Safe Storage actions.
 2. Implement Water Source WSP actions.
 3. Implement all other necessary WSP actions.

Why?


Contaminated source where bacteria has died in storage. Re-contaminated in the Household.

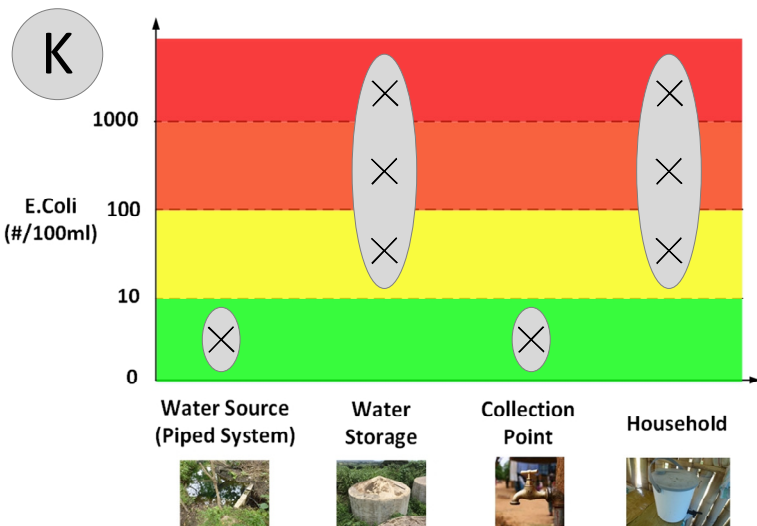

ACTIONS
 1. Implement Household Water Treatment and Safe Storage actions.
 2. Implement Water Storage WSP actions.
 3. Implement all other necessary WSP actions.

Why?


Clean water source contaminated in water storage and Household.

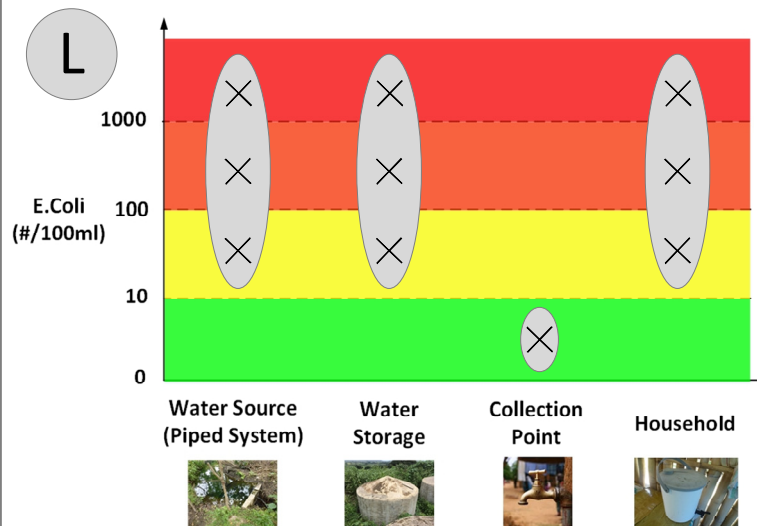

ACTIONS
 1. Implement Household Water Treatment and Safe Storage actions.
 2. Implement Water Source and Storage WSP actions.
 3. Implement all other necessary WSP actions.


Why?

Contaminated source treated before collection point. Re-contaminated in the Household.

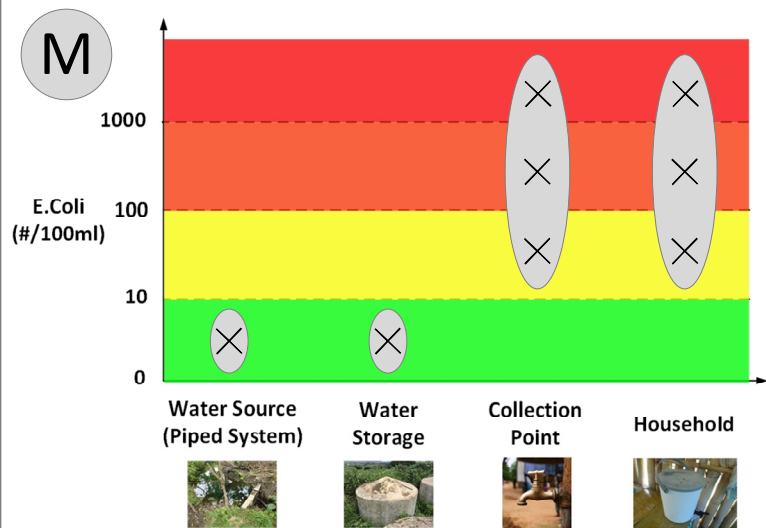


- ACTIONS**
1. Implement Household Water Treatment and Safe Storage actions.
 2. Implement Collection Point WSP actions.
 3. Implement all other necessary WSP actions.

Why?
Acceptable quality source contaminated at collection points. Not treated at the household.

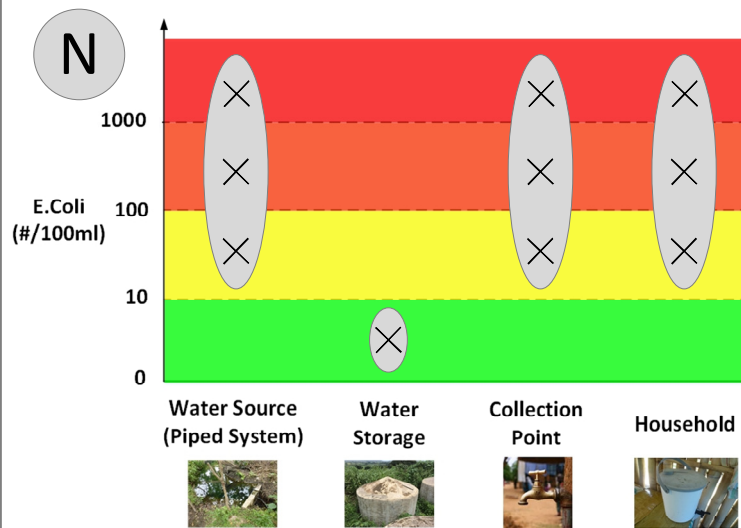


- ACTIONS**
1. Implement Household Water Storage and Safe Storage WSP actions.
 2. Implement Collection Point WSP actions.
 3. Implement Water Source WSP actions.
 4. Implement any other necessary WSP actions.

Why?
Contaminated source where bacteria has died in storage, or water is treated prior to storage. Re-contaminated at collection point; not treated at HH.

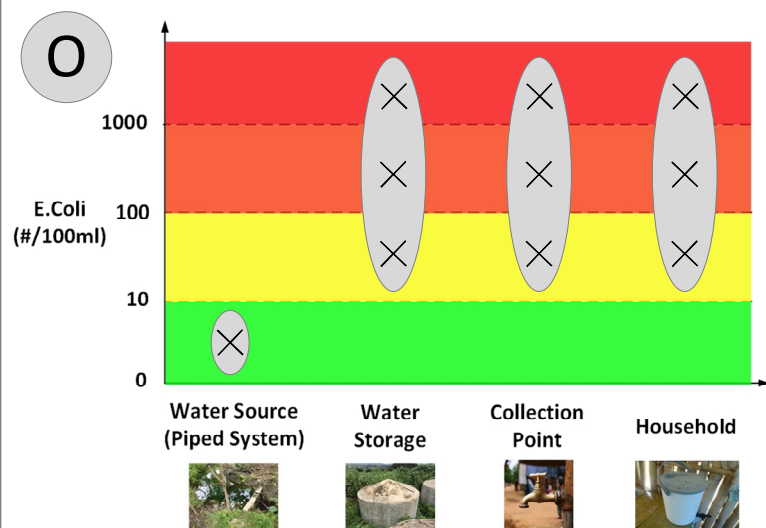

- ACTIONS**
1. Implement Household Treatment and Safe Storage WSP actions.
 2. Implement Water Storage and Collection Point WSP actions.
 3. Implement all other necessary WSP actions.

Why?
Acceptable quality source contaminated in storage tank and collection point. Not treated in the household.

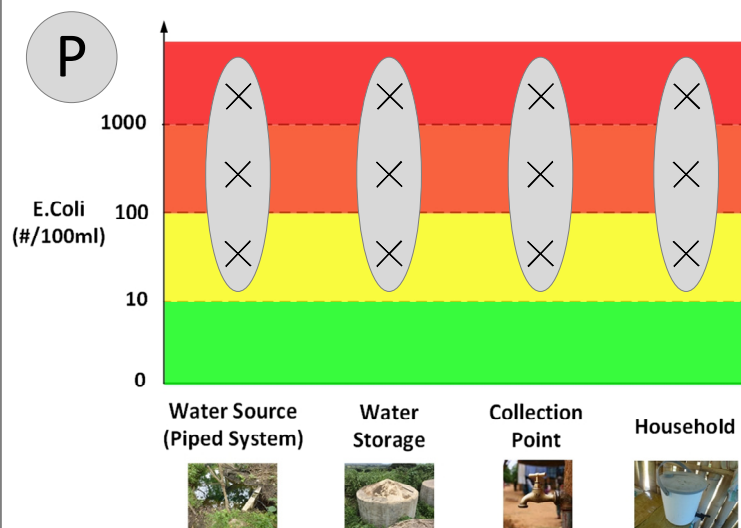

- ACTIONS**
1. Implement Household Treatment and Safe Storage WSP actions.
 2. Implement full WSP actions across the whole system.

Why?
Contaminated source remains contaminated up to consumer. No household treatment.